

**Smoke Damper • Airfoil Blades • Leakage Class II • 250°F or 350°F • Galvanized Steel****STANDARD CONSTRUCTION**


- FRAME:** 5½" x 7/8" x 16 GA. galvanized steel hat channel. A flat head and sill are used for sizes up to 13" high.
- BLADES:** 20 GA. galvanized steel double skinned (equal to 14 GA.), parallel action.
- AXLES:** Plated solid steel stub.
- BEARINGS:** Oil impregnated bronze.
- LINKAGE:** Plated steel angle and crank plates with stainless steel pivots, in-jamb type.
- STOPS:** 18 GA. galvanized steel at head and sill.
- BLADE SEALS:** Silicone.
- JAMB SEALS:** Stainless steel.
- SLEEVE:** Minimum 20 GA. galvanized steel by 18" long (sizes greater than 84" wide or 84" high require minimum 18 GA.).
- CAULKING:** Hardcast Irongrip 601 or UL-listed equivalent.
- FINISH:** Mill on galvanized steel.
- ACTUATOR:** Electric or pneumatic, factory-installed for power-open/spring-close (fail close) operation. External left-hand mounted as viewed from jackshaft side of damper.

**OPTIONS**

Exact Size (no undercut)  
 Flange - Front, Rear or Both  
 Actuators - 120V, 24V, 230V, Pneumatic  
 Right Hand and/or Internal Actuator Mounting Locations (restrictions apply)  
 Dual Position Indication (IDPI) switches  
 Model SM-501 Flow-Rated smoke detector  
 Model 2151 No-Flow smoke detector (12" minimum damper height)  
 Remote test box  
 Momentary test switch  
 Transformers  
 Tab-Lock retaining angles - 1 or 2 sets  
 Stainless steel bearings  
 Stainless steel axles  
 Copper tubing (pneumatic actuator)  
 Sleeves of various depths and gauge thicknesses (restrictions apply)  
 No sleeve or sideplate (restrictions apply)  
 Round or oval transitions  
 Security bars  
 Short-width (less than 8") and/or short-height (less than 6") transitions


**NOTES**

- Nominal deductions will be made to the opening size given.
- Dampers greater than or equal to 12" in height with factory mounted SM-501 smoke detectors require a minimum 19" deep sleeve (10½" on the actuator side). Detectors will be mounted on the side of the damper opposite actuator.
- Dampers less than 12" in height with factory mounted SM-501 smoke detectors require a minimum 20 deep sleeve (11½" on the actuator side). Detectors will be mounted on the bottom or top of damper.
- Smoke detectors can be ordered for field mounting with standard 18" deep sleeve.

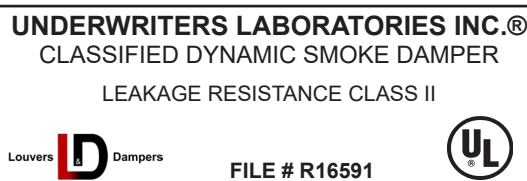

This smoke damper meets the construction and performance requirements of:

- Underwriters Laboratories Inc. Standards 555S
- National Fire Protection Association Standards 80 and 90A
- ICC's International Building Code
- New York City MEA Listing #112-99-M
- California State Fire Marshal Listing #3230-1328:111
- Underwriters Laboratories Inc. Approved for dual direction airflow and dynamic conditions.
- Underwriters Laboratories Inc. Classified for use in smoke control systems for Leakage Class II and 250°F or 350°F.
- Actuators must be controlled by a smoke detection system.

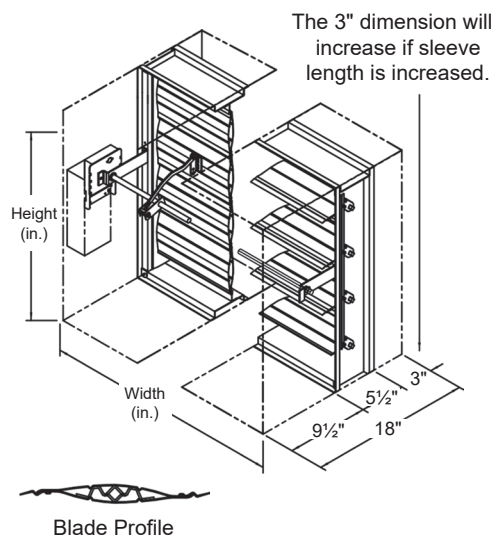

Item #	Qty	Damper Size	Horizontal	Vertical	250°F	350°F	Velocity	Pressure		
			Orientation		Temp. Rating		Operational Rating		Union Made	
Arch. / Eng.:					EDR:		ECN:		Job:	
Contractor:										
Project:					Date:		DWN:		DWG:	

In the interest of product development, Louvers & Dampers reserves the right to make changes without notice.

[www.louvers-dampers.com](http://www.louvers-dampers.com)

450 Riverside Drive • Wyalusing PA, 18853 • Phone 570-746-1888 • Fax 570-746-9286

**Louvers & Dampers**  
A Mestek Company

**Smoke Damper • Airfoil Blades • Leakage Class II • 250°F or 350°F • Galvanized Steel****OPERATIONAL RATING**

Maximum Differential Pressure: 4 in. w.g. (6 in. w.g. for selected size/actuator combinations)  
 Maximum Velocity: 2000 fpm (4000 fpm for selected size/actuator combinations)

**LEAKAGE RATING**

UL Class II


10 cfm per sq. ft. maximum @ 1 in. wg

20 cfm per sq. ft. maximum @ 4 in. wg

24.5 cfm per sq.ft. maximum @ 6 in. wg

**PRESSURE DROP RATING**

The pressure drop data shown below is based on laboratory conditions. The test setup does not take into account elbows or other duct fittings that are part of every actual duct system. The configuration of the actual duct system immediately upstream and downstream of the damper often contributes more pressure loss than the damper itself.

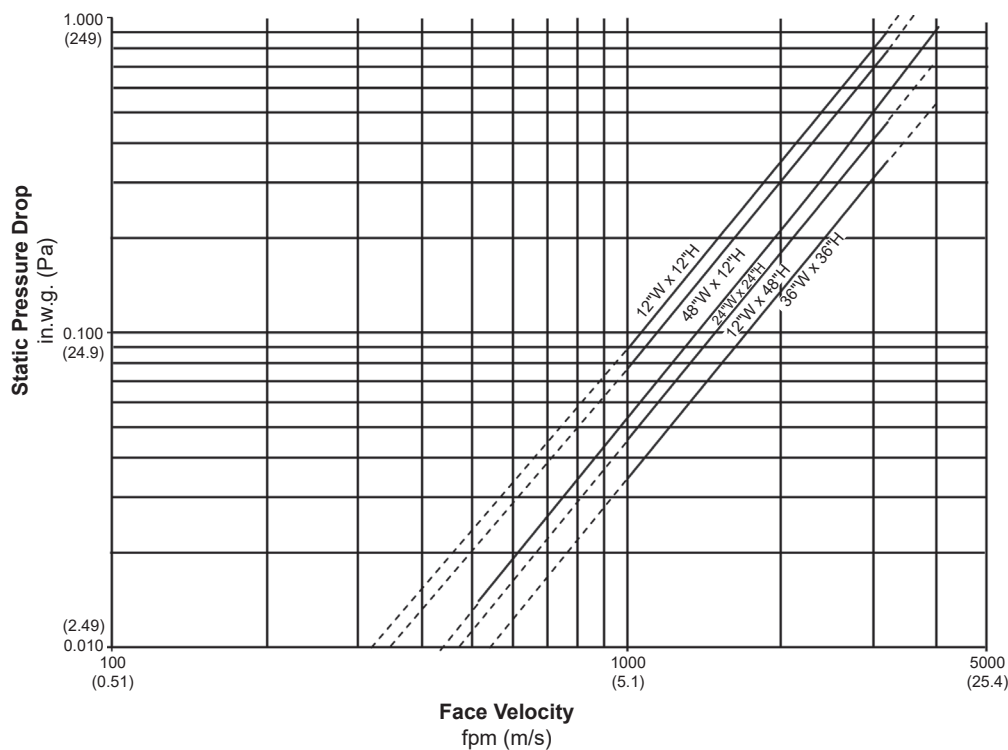

Tested in accordance with AMCA Standard 500D, Figure 5.3  
 Intake air converted to standard air density.



Louvers & Dampers certifies that the model KA2 damper shown here is licensed to bear the AMCA seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Ratings Seal applies to Air Performance Ratings only.

**Smoke Damper • Airfoil Blades • Leakage Class II • 250°F or 350°F • Galvanized Steel****SIZING CHART**

Damper Style	Temp Rating	Velocity & Pressure	Horizontal and Vertical Min Panel	Horizontal and Vertical Max Panel	Horizontal and Vertical Max Assembly
No Transition	250°F or 350°F	2000 FPM, 4 in. w.g.	8" x 6" frame	36" x 48" frame	144" x 96" frame -or- 288" x 48" frame
		3000 FPM, 4 in. w.g.		24" x 36" frame -or- 36" x 24" frame	96" x 72" frame 96" x 36" frame -or- 108" x 24" frame
		4000 FPM, 4 in. w.g.			
	250°F	4000 FPM, 6 in. w.g.		24" x 24" frame	96" x 24" frame
	350°F	4000 FPM, 6 in. w.g. (external actuator only)		16" x 24" frame	32" x 24" frame
C-Round -or- C-Square	250°F or 350°F	2000 FPM, 4 in. w.g.	4" dia. duct -or- 4" x 4" duct  (8" x 6" frame)	34" dia. duct -or- 34" x 34" duct	81" dia. duct -or- 81" x 81" duct
		3000 FPM, 4 in. w.g.		22" dia. duct -or- 22" x 22" duct	70" dia. duct -or- 70" x 70" duct
		4000 FPM, 4 in. w.g.			34" dia. -or- 34" x 34" duct
	250°F	4000 FPM, 6 in. w.g.		22" dia. duct -or- 22" x 22" duct	
	350°F	4000 FPM, 6 in. w.g. (external actuator only)		14" dia. duct -or- 14" x 14" duct	22" dia. duct -or- 22" x 22" duct
C-Oval -or- C-Rectangle	250°F or 350°F	2000 FPM, 4 in. w.g.	4" dia. duct  (8" x 6" frame)	34" x 46" duct	70" x 94" duct -or- 94" x 70" duct
		3000 FPM, 4 in. w.g.		22" x 34" duct -or- 34" x 22" duct	94" x 70" duct 94" x 34" duct -or- 106" x 22" duct
		4000 FPM, 4 in. w.g.			
	250°F	4000 FPM, 6 in. w.g.		22" x 22" duct	94" x 22" duct
	350°F	4000 FPM, 6 in. w.g. (external actuator only)		14" x 22" duct	30" x 22" duct

All dimensions are shown as width x height.

For dampers with no transition, the order size will equal frame size, which should equal duct size.

Unless notes, duct size will be the order size.

For dampers with transitions, the damper's frame size will equal the order width + 2 inches x the order height plus 2 inches.

When using a true 6" high damper, width is limited to 16". If damper is ordered as 6" high and width is less than 16", an 8" high damper with 2" short-height transition will be supplied.