

Application & Features

- Intake/Exhaust air louvers are designed to pass air through the openings in the buildings exterior walls while keeping out unwanted elements such as water , dirt, debris and other elements.
- It is used in industrial, commercial and domestic applications.
- Rugged assembly provides long term durability.
- Suitable for installation in inlet of fresh air intake ducts, exhaust ducts and external wall openings.
- Rear mounted volume control damper, filters are available as optional.
- Tested by AMCA as per ANSI/AMCA-500L-12 " Laboratory Methods of Testing Louvers for Rating" for the air performance.

Construction Details

- **Frame** : Galvanized steel Frame
- **Blades** : Galvanized steel blades are fixed horizontally at 45 degree downward. Downward deflection prevents rain water ingress.
- **Screen** : 7 x 12mm Galvanized steel bird screen (standard)/ Stainless Steel Bird screen (optional).
- **Installation** : Vertically on external wall or direct to duct
- **Shape** : Square or Rectangular
- **Size** : Minimum size - 300 x 300mm
Maximum size - 2000 x 2000mm (single section)
- **Filter** : 25mm and 50mm thickness Aluminium washable filter (optional).
- **Damper** : Galvanized steel volume control damper (optional).
- **Finish** : Electrostatic polyester powder coated RAL9010 finish (standard). Other colors are available as option




Century Mechanical Systems Factory LLC certifies that the Model: FAL-A/GI shown herein is Licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The Certified Ratings Seal applies to Air Performance and Water Penetration Ratings. Tested in accordance with ANSI/AMCA Standard 500-L-12 for Pressure Drop and Water Penetration.


Air Louvers

Intake/Exhaust Air Louver


Model: FAL-A/GI
[Standard] Intake/Exhaust
Air Louver

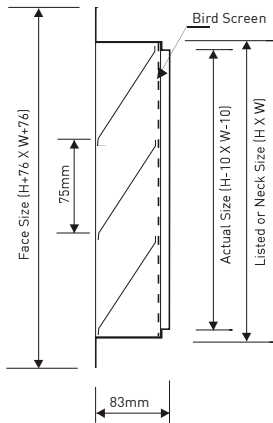

Model: FAL-A/GI+F
Intake/Exhaust Air Louver
with Aluminium Filter

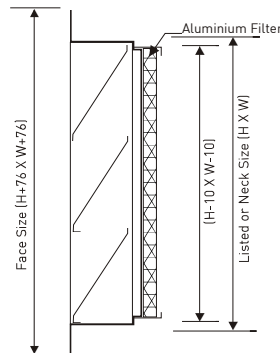


Model: FAL-A/GI+F+D
Intake/Exhaust Air Louver
with Filter and Volume Control Damper

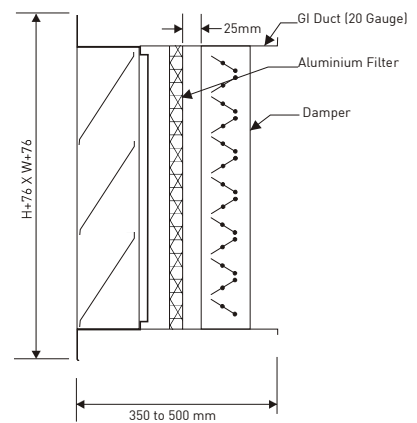


INSTALLATION DETAILS

Intake/Exhaust Air Louver
[FAL-A/GI]

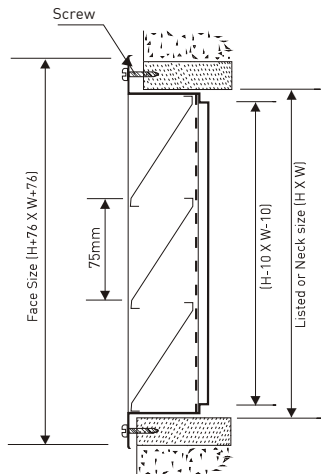

Intake/Exhaust Air Louver
with Filter and Volume Control Damper
[FAL-A/GI+F+D]

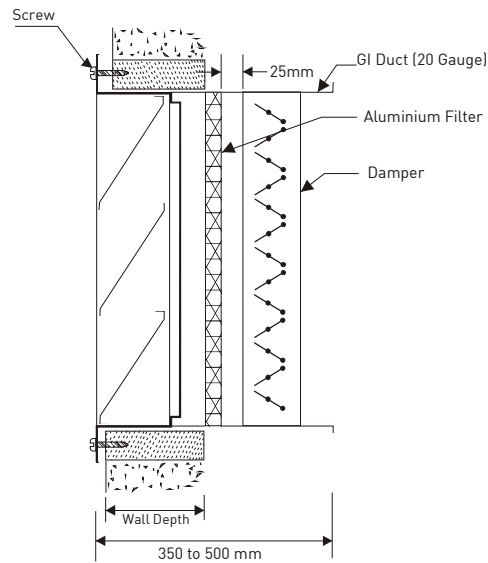

*Contact CMS for the details of multi section installation.



Century Mechanical Systems Factory LLC certifies that the Model: FAL-A/GI shown herein is Licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The Certified Ratings Seal applies to Air Performance and Water Penetration Ratings. Tested in accordance with ANSI/AMCA Standard 500-L-12 for Pressure Drop and Water Penetration.

Air Louvers

Intake/Exhaust Air Louver


Free Area Chart - Intake/Exhaust Air Louver [FAL-A/GI]:

		Louver Width in Inches (mm)														
		12	18	24	30	36	42	48	54	60	66	72	78	84	90	96
Louver Height in Inches (mm)	12	0.27	0.45	0.63	0.81	0.99	1.17	1.35	1.53	1.72	1.90	2.08	2.26	2.44	2.62	2.80
	300	0.03	0.04	0.06	0.08	0.09	0.11	0.13	0.14	0.16	0.18	0.19	0.21	0.23	0.24	0.26
	18	0.45	0.75	1.05	1.35	1.65	1.96	2.26	2.56	2.86	3.16	3.46	3.76	4.06	4.36	4.66
	450	0.04	0.07	0.10	0.13	0.15	0.18	0.21	0.24	0.27	0.29	0.32	0.35	0.38	0.41	0.43
	24	0.63	1.05	1.47	1.90	2.32	2.74	3.16	3.58	4.00	4.42	4.84	5.27	5.69	6.11	6.53
	600	0.06	0.10	0.14	0.18	0.22	0.25	0.29	0.33	0.37	0.41	0.45	0.49	0.53	0.57	0.61
	30	0.81	1.35	1.90	2.44	2.98	3.52	4.06	4.60	5.15	5.69	6.23	6.77	7.31	7.85	8.39
	750	0.08	0.13	0.18	0.23	0.28	0.33	0.38	0.43	0.48	0.53	0.58	0.63	0.68	0.73	0.78
	36	0.99	1.65	2.32	2.98	3.64	4.30	4.96	5.63	6.29	6.95	7.61	8.27	8.94	9.60	10.26
	900	0.09	0.15	0.22	0.28	0.34	0.40	0.46	0.52	0.58	0.65	0.71	0.77	0.83	0.89	0.95
	42	1.17	1.96	2.74	3.52	4.30	5.09	5.87	6.65	7.43	8.21	9.00	9.78	10.56	11.34	12.13
	1050	0.11	0.18	0.25	0.33	0.40	0.47	0.55	0.62	0.69	0.76	0.84	0.91	0.98	1.05	1.13
	48	1.35	2.26	3.16	4.06	4.96	5.87	6.77	7.67	8.58	9.48	10.38	11.28	12.19	13.09	13.99
	1200	0.13	0.21	0.29	0.38	0.46	0.55	0.63	0.71	0.80	0.88	0.96	1.05	1.13	1.22	1.30
	54	1.53	2.56	3.58	4.60	5.63	6.65	7.67	8.70	9.72	10.74	11.76	12.79	13.81	14.83	15.86
	1350	0.14	0.24	0.33	0.43	0.52	0.62	0.71	0.81	0.90	1.00	1.09	1.19	1.28	1.38	1.47
	60	1.72	2.86	4.00	5.15	6.29	7.43	8.58	9.72	10.86	12.01	13.15	14.29	15.44	16.58	17.72
	1500	0.16	0.27	0.37	0.48	0.58	0.69	0.80	0.90	1.01	1.12	1.22	1.33	1.43	1.54	1.65
	66	1.90	3.16	4.42	5.69	6.95	8.21	9.48	10.74	12.01	13.27	14.53	15.80	17.06	18.32	19.59
	1650	0.18	0.29	0.41	0.53	0.65	0.76	0.88	1.00	1.12	1.23	1.35	1.47	1.58	1.70	1.82
72	2.08	3.46	4.84	6.23	7.61	9.00	10.38	11.76	13.15	14.53	15.92	17.30	18.69	20.07	21.45	
1800	0.19	0.32	0.45	0.58	0.71	0.84	0.96	1.09	1.22	1.35	1.48	1.61	1.74	1.86	1.99	
78	2.26	3.76	5.27	6.77	8.27	9.78	11.28	12.79	14.29	15.80	17.30	18.81	20.31	21.81	23.32	
1950	0.21	0.35	0.49	0.63	0.77	0.91	1.05	1.19	1.33	1.47	1.61	1.75	1.89	2.03	2.17	
84	2.44	4.06	5.69	7.31	8.94	10.56	12.19	13.81	15.44	17.06	18.69	20.31	21.93	23.56	25.18	
2100	0.23	0.38	0.53	0.68	0.83	0.98	1.13	1.28	1.43	1.58	1.74	1.89	2.04	2.19	2.34	
90	2.62	4.36	6.11	7.85	9.60	11.34	13.09	14.83	16.58	18.32	20.07	21.81	23.56	25.30	27.05	
2250	0.24	0.41	0.57	0.73	0.89	1.05	1.22	1.38	1.54	1.70	1.86	2.03	2.19	2.35	2.51	
96	2.80	4.66	6.53	8.39	10.26	12.13	13.99	15.86	17.72	19.59	21.45	23.32	25.18	27.05	28.92	
2400	0.26	0.43	0.61	0.78	0.95	1.13	1.30	1.47	1.65	1.82	1.99	2.17	2.34	2.51	2.69	

Neck Width = outer width -76mm

Neck Height = Outer Height -76mm

Intake Air Performance

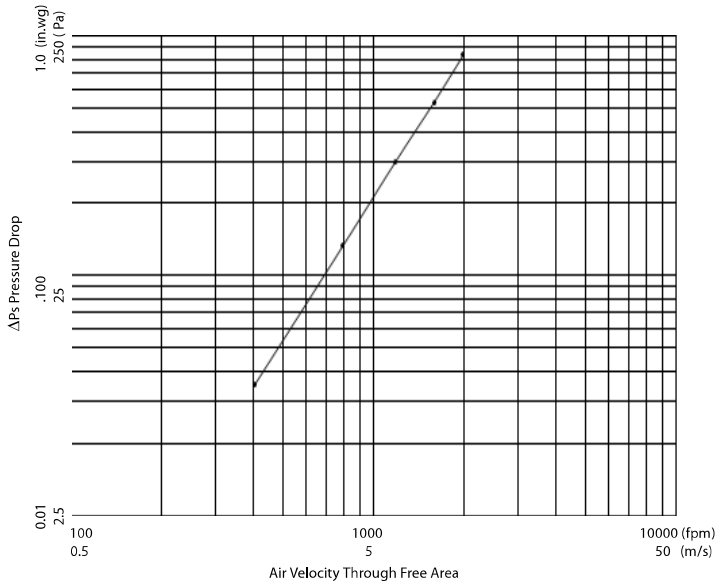

Test Results			
Free Area Velocity		Pressure Drop	
fpm	m/s	inch.wg	Pa
404	2.02	0.035	9
791	3.96	0.133	33
1181	5.91	0.299	75
1587	7.94	0.531	133
1979	9.9	0.833	208

AMCA Standard 500-L Intake Test Figure 5.5 setup for size - 48" x 48" (outer dimension) Data is corrected to standard air density

Selection Example:

Given:
Airflow: 4400cfm
Free area velocity : 600fpm (Assumed)

Calculation:
Free Area = Airflow/ louver free area velocity
= 4400/600
= 7.33 ft²


From Free Area Chart, selected size of the louver is 48" X 48"
From the graph, Louver pressure drop = 0.075 in.wg.

If the required Free Area is not available in the chart then please apply the following formula,
Total Louver Neck Area = Free Area/0.48



Century Mechanical Systems Factory LLC certifies that the Model: FAL-A/GI shown herein is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Ratings Seal applies to Air Performance and Water Penetration Ratings only. Tested in accordance with ANSI/AMCA Standard 500-L-12 for Pressure Drop and Water Penetration.

Exhaust Air Performance

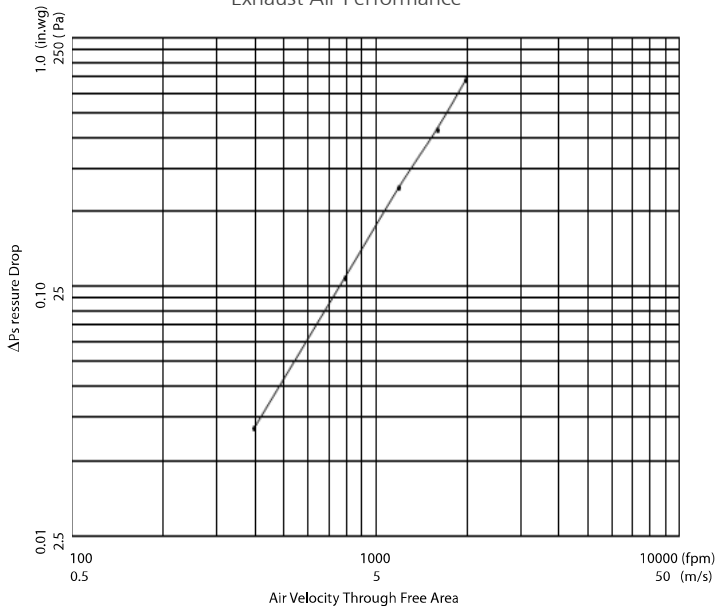

Test Results			
Free Area Velocity		Pressure Drop	
fpm	m/s	inch.wg	Pa
397	1.99	0.027	7
790	3.95	0.109	27
1187	5.94	0.25	63
1586	7.93	0.43	108
1980	9.9	0.682	171

AMCA Standard 500-L Intake Test Figure 5.5 setup for size - 48" x 48" (outer dimension) Data is corrected to standard air density


Selection Example:

Given:
Airflow: 4400cfm
Free area velocity : 600fpm (Assumed)

Calculation:
Free Area = Airflow/ louver free area velocity
= 4400/600
= 7.33ft²

From Free Area Chart, selected size of the louver is 48" X 48"
From the graph, Louver pressure drop = 0.062 in.wg

Water Penetration Graph [Intake/Exhaust]

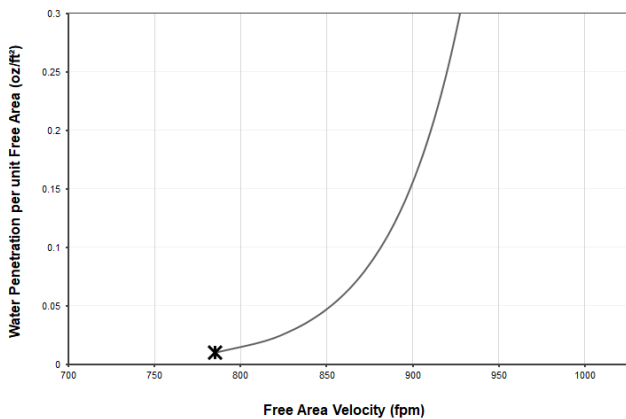

Beginning of water penetration @787.1fpm

Test Results			
Free Area Velocity		Pressure Drop	
fpm	m/s	oz/ft ²	gram/m ²
690	3.45	0.001	0.31
736	3.68	0.003	0.92
785	3.93	0.013	3.97
836	4.18	0.028	8.54

Beginning of water penetration as per AMCA publication 511 section 8.3.2 based on AMCA measure free area is 787.1 fpm Tested with AMCA standard 500-L-07 Water Penetration



Century Mechanical Systems Factory LLC certifies that the Model: FAL-A/GI shown herein is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Ratings Seal applies to Air Performance and Water Penetration Ratings only. Tested in accordance with ANSI/AMCA Standard 500-L-12 for Pressure Drop and Water Penetration.