

Application

The SD-152 smoke damper employs airfoil blades for point-of-origin control of smoke in static and dynamic smoke management systems. The SD-152 is qualified to 4,000 ft/min (20.3 m/s) and 8 in.wg. (2.0 kPa) and may be installed in, or adjacent to vertical walls or partitions, or horizontally in, or adjacent to floors or assemblies.

Standard Construction

Frame: 5" x 1" (127 x 25) galvanized steel hat channel with interlocking corner gusset. Equivalent to 13 gauge (2.4) channel frame. Low profile head and sill are used on sizes less than 13" (330) high.

Blades: 6" x 14 gauge (152 x 2.0) equivalent galvanized steel airfoil.

Side-Plate: 12" x 20 gauge (305 x 1.0) galvanized steel.

Axles: 1/2" (13) diameter plated steel hex.

Linkage: Concealed in frame.

Bearings: Stainless steel oilite, sleeve-type.

Seals: Silicone blade edge seals integrally rolled and mechanically fastened to blades. Flexible metal jamb seals.

Actuator: 120 VAC, power-open, spring-close, external mount.

Minimum Size: 8" x 6" (203 x 152)

Maximum Size:** Single section: 36" x 48" (914 x 1219)
Multiple Section: 144" x 96" (3658 x 2438) or
288" x 48" (7315 x 1219)

Options

- ☐ Alternate actuator: (Power-open, spring close)
 - ☐ Internal mount (actuator in air-stream).
 - ☐ 24 VAC ☐ 230 VAC ☐ Pneumatic ☐ 24V Modulating**
 - ☐ Opposed blade
 - ☐ Parallel blade
- ☐ Alternate power-close, spring-open position.
 - ☐ Internal mount (actuator in air-stream).
 - ☐ 24 VAC ☐ 230 VAC
- ☐ PI-50 — Dual position indicator switch package.
- ☐ Factory installed sleeve:
 - Gauge: ☐ 20 (1.0) ☐ 18 (1.3) ☐ 16 (1.6)
 - ☐ 14 (2.0) ☐ 10 (3.5)
 - Length: ☐ 12" (305) ☐ 16" (406) ☐ 24" (610) ☐ Other _____
- ☐ Transitions (sleeve required): ☐ Flanged
 - ☐ Round ☐ Oval
 - ☐ Duct connections: ☐ 1" (25) S-slip
 - ☐ DM25 ☐ DM35 ☐ S & Drive ☐ Ward
- ☐ Retaining angle systems:
 - Gauge: ☐ 20 (1.0) ☐ 16 (1.6)
 - Picture frame: ☐ SSPF (single-side) ☐ DSPF (2-sided)
 - Individual angle sets: ☐ SS (single-side) ☐ DS (2-sided)
- ☐ Duct smoke detector factory mounted and wired (sleeve required):
 - ☐ D4120 (100-4,000 fpm [0.5-20.3 m/s])
 - ☐ 2151 (0-3,000 fpm [0-15.2 m/s])
- ☐ Duct access door factory mounted in common sleeve.
- ☐ Remote control stations:
 - ☐ RCP-1 (single) ☐ RCP-1K (single, key controlled)
 - ☐ RCP-1M (single, momentary switch)

Ratings

UL 555S Leakage Class: 2 [20 cfm/sq.ft. @ 4 in.wg.]
[(0.10 m³/s/m² @ 1.0 kPa)]

Maximum Dynamic Closure Velocity:** 4,000 fpm (20.3 m/s)

Maximum UL555S Rated Pressure: 8 in.wg. (2.0 kPa)

Maximum Temperature:** 350°F (177°C)

Listings


UL 555S listing: R11767

CSFM listing: 3230-0368:116


New York City MEA listing: 295-98-E

Meets NFPA Standards: 90A, 92A, 92B and 101


Meets Building Code Standards: IBC, NBC, NFPA, SBC and UBC




Sleeve (optional)



Sleeve Type R
(optional)
Round duct transitions are standard with D=W=H. (available with D<W and H)



Sleeve Type O (optional)
Oval duct transitions are standard with W and H equal to damper width and height dimensions. (available with W and H smaller than damper width and height)

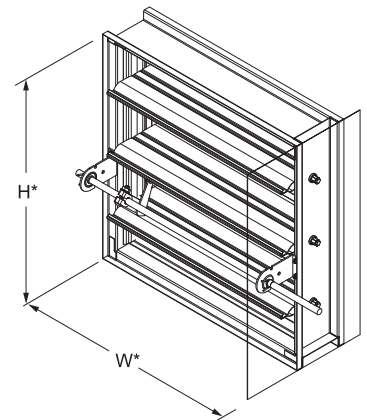

Model SD-152
(standard)

*Damper dimensions furnished approximately 1/4" (6) undersize.

*Damper dimensions furnished approximately 1/4" (6) undersize. (sleeve thickness not included)

** Special Sizing	Power Close Option	24V Modulating Option
Maximum Single Section	36" x 36" (914 x 914)	36" x 24" (914 x 610)
Maximum Multiple Section:	288" x 36" (7315 x 914)	144" x 48" or 288" x 24" (3658 x 1219 or 7315 x 610)
Maximum Dynamic Closure Velocity:	2000 fpm (10.2 m/s)	2000 fpm (10.2 m/s)
Maximum Temperature:	250° F (121° C)	250° F (121° C)



Air Performance
Pottorff certifies that the model SD-152 shown herein is licensed to bear the AMCA seal. The ratings shown are based on tests and procedures performed in accordance with AMCA publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Ratings Seal applies to air performance ratings only.





Actuator and Sleeve Dimensional Data

The drawings and corresponding table illustrate the position of the damper when mounted in a factory sleeve and the relative space required for a given actuator. The standard mounting locations provide enough space for installation of retaining angles and duct connections.

Damper Height		Actuator Model						
		FSLF120 FSLF24	FSNF120 FSNF24	GGD221 GGD121	ML4115 ML8115	MS4120 MS8120	331-4826	331-2998
F	8"-9"	4"	7"	8"	4"	8"	8"	12"
	10"-11"	1"	4"	6"	1"	5"	5"	9"
	12"-13"	1"	3"	5"	0"	4"	4"	8"
	14"	0"	2"	4"	0"	3"	3"	8"
	15"-16"	0"	1"	3"	0"	2"	2"	7"
	17"	0"	3"	5"	0"	4"	5"	9"
	18" and 23"	0"	0"	0"	0"	0"	0"	3"
T	19"-20" and 25"	0"	0"	0"	0"	0"	0"	2"
	21"-22" and 24"	0"	0"	0"	0"	0"	0"	0"
	26"-27"	0"	0"	0"	0"	0"	0"	1"
	>27"	0"	0"	0"	0"	0"	0"	0"
S	All	4-1/2"	4-1/2"	4-1/2"	4-1/2"	4-1/2"	5"	7-1/4"
X	<8"	4"	4"	4"	4"	4"	4"	4"
	≥8"	2-5/8"	2-5/8"	2-5/8"	2-5/8"	2-5/8"	2-5/8"	2-5/8"
J	<8"	2"	2"	2"	2"	2"	2"	2"
	≥8"	3-3/8"	3-3/8"	3-3/8"	3-3/8"	3-3/8"	3-3/8"	3-3/8"

- NOTE:**
- Sleeve length "L" = wall/floor thickness + 10" (254). Standard sleeve length "L" = 16" (406).
 - Damper may be rotated 180° to position actuator area on the left side.
 - The entire damper frame is not required to be installed within the wall, partition or floor. However, the closed plane of the damper blades must be within 24" (610) of the wall, partition or floor.
 - Dimensions for FSLF120 apply to FSTF120.
 - Dimensions for FSNF24 apply to FSAFB24-SR and FSAFB24.
 - Dimensions for ML4115/ML8115 apply to MS4209/MS8209.
 - For dimensions on actuators not shown above, contact factory.

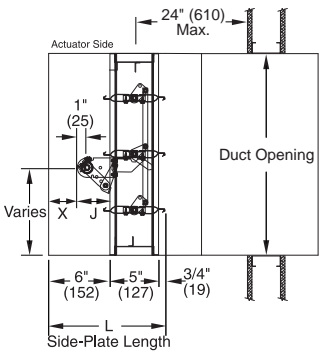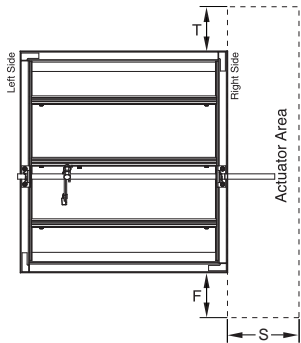

Airflow Performance Data

Pressure Loss vs. Velocity

Figure 5.3 — Ducted Inlet and Outlet

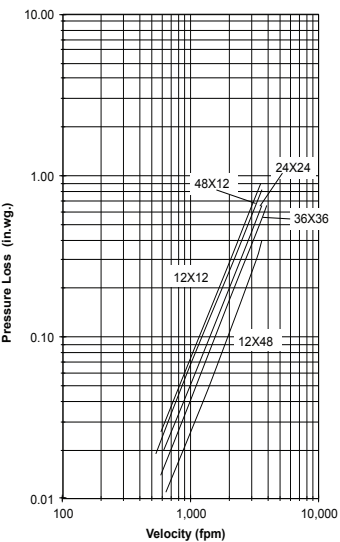


Figure 5.2 — Ducted Inlet



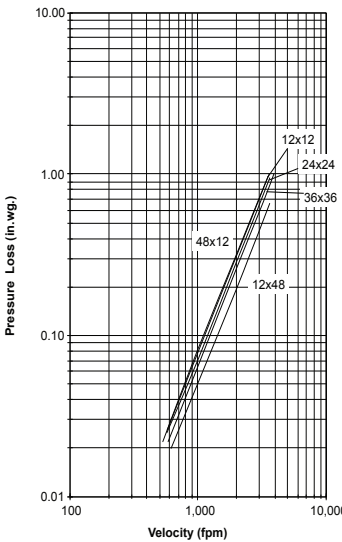


Figure 5.5 Plenum Mount

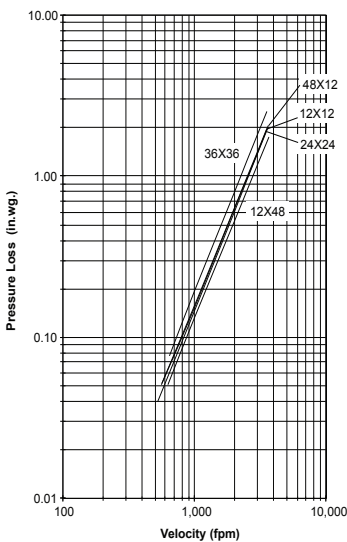


Air Performance
Pottorff certifies that the model SD-152 shown herein is licensed to bear the AMCA seal. The ratings shown are based on tests and procedures performed in accordance with AMCA publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Ratings Seal applies to air performance ratings only.

Pressure drop testing was performed in accordance with AMCA Standard 500-D using the three configurations shown. All data has been corrected to represent air density of 0.075 lb/ft. Actual pressure drop in any ducted HVAC system is a combination of many elements. This information, along with analysis of other system influences, should be used to estimate actual pressure losses for a damper installed in a given HVAC system.



Ducted Inlet and Outlet

AMCA Figure 5.3 Illustrates a fully ducted damper. This configuration represents the lowest pressure drop of the three test configurations because entrance and exit losses are minimized by straight duct runs upstream and downstream of the damper.



Ducted Inlet

AMCA Figure 5.2 Illustrates a ducted damper exhausting air into an open area. This configuration has a lower pressure drop than Figure 5.5 because entrance losses are minimized by a straight duct run upstream of the damper.



Plenum Mount

AMCA Figure 5.5 Illustrates a plenum mounted damper. This configuration has the highest pressure drop because of extremely high entrance and exit losses due to the sudden changes of area in the system.