


Standard Construction

Fame	Heavy gauge extruded 6063-T5 aluminum, 6 in. (152 mm) x 0.125 in. (3 mm) nominal wall thickness
Blades	Drainable design, heavy gauge extruded 6063-T5 aluminum, 0.081 in. (2 mm) nominal wall thickness, positioned 45° on approximately 6.5 in. (165 mm) centers
Seals	Dual-durometer extruded vinyl blade seals, compressible stainless steel jamb seals
Temperature Restrictions	(-20° F) - (+180° F) (-29° C) - (+82° C)
Linkage	Side linkage, out of airstream (concealed in frame)
Bearings	Synthetic sleeve type
Axles	1/2 in. (13 mm) dia. zinc plated steel
Louver Depth	6 in. (152 mm)
Construction	Mechanically fastened
Finish	Mill
Minimum Size	12 in. W x 16 in. H (305 mm W x 406 mm H)
Maximum Single Section Size	60 in. W x 96 in. H (1524 mm W x 2438 mm H)
Wind Load	25 PSF (1.2 kPa)



Performance Ratings



Greenheck Fan Corporation certifies that the EAC-601 louvers shown herein are licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Ratings Seal applies to Water Penetration and Air Performance ratings.

Louvers were tested in accordance with AMCA Standard 500-L.

Performance of 48 in. x 48 in. (1219 mm x 1219 mm) Louver

Free Area	Area 7.41 sq. ft. (0.688 sq. m) Percent 46.3%
Performance at Beginning Point of Water Penetration	Free Area Velocity 1024 fpm (5.202 m/s) Max Intake Volume 7588 cfm (3.581 m³/s)
Performance at 6,000 CFM (2.832 m³/s) Intake	Pressure Drop 0.082 in. wg (0.020 kPa)

Options and Accessories

- Actuators
- [Bird Screen](#)
- [Extended Sill](#)
- [Filter Rack/Filter](#)
- [Flange Frame](#)
- [Glazing Frame](#)
- [Insect Screen](#)
- [Mounting Angles](#)
- [Security Bars](#)
- Stainless Steel Axles and Bearings
- [Variety of Architectural Finishes](#)

Product Details

[EAC-601 Leakage Chart](#)

[EAC-601 Standard Details](#)

Structural reinforcing members may be required to adequately support and install multiple louver sections within a large opening. Structural reinforcing members along with any associated installation hardware is not provided by Greenheck unless indicated otherwise by Greenheck. Options and accessories including, but not limited to, screens, filter racks, louver doors, and blank off panels are not subject to structural analysis unless indicated otherwise by Greenheck.

Free Area Chart

Free Area Chart shows free area in square feet and square meters.

Louver Height Inches (Meters)	Louver Width in Inches (Meters)													
	12	15	18	21	24	27	30	33	36	39	42	48	54	60
0.30	0.38	0.46	0.53	0.61	0.69	0.76	0.84	0.91	0.99	1.07	1.22	1.37	1.52	
16	0.23	0.30	0.38	0.45	0.53	0.60	0.68	0.75	0.83	0.90	0.98	1.13	1.27	1.42
0.41	0.02	0.03	0.04	0.04	0.05	0.06	0.06	0.07	0.08	0.08	0.09	0.10	0.12	0.13
21	0.49	0.64	0.80	0.96	1.12	1.28	1.43	1.59	1.75	1.91	2.07	2.38	2.70	3.01
0.53	0.05	0.06	0.07	0.09	0.10	0.12	0.13	0.15	0.16	0.18	0.19	0.22	0.25	0.28
24	0.49	0.64	0.80	0.96	1.12	1.28	1.43	1.59	1.75	1.91	2.07	2.38	2.70	3.01
0.61	0.05	0.06	0.07	0.09	0.10	0.12	0.13	0.15	0.16	0.18	0.19	0.22	0.25	0.28
30	0.74	0.99	1.23	1.47	1.71	1.95	2.19	2.43	2.67	2.92	3.16	3.64	4.12	4.60
0.76	0.07	0.09	0.11	0.14	0.16	0.18	0.20	0.23	0.25	0.27	0.29	0.34	0.38	0.43
33	1.00	1.33	1.65	1.97	2.30	2.62	2.95	3.27	3.60	3.92	4.25	4.90	5.55	6.19
0.84	0.09	0.12	0.15	0.18	0.21	0.24	0.27	0.30	0.33	0.36	0.39	0.46	0.52	0.58
39	1.00	1.33	1.65	1.97	2.30	2.62	2.95	3.27	3.60	3.92	4.25	4.90	5.55	6.19
0.99	0.09	0.12	0.15	0.18	0.21	0.24	0.27	0.30	0.33	0.36	0.39	0.46	0.52	0.58
42	1.26	1.67	2.07	2.48	2.89	3.30	3.71	4.11	4.52	4.93	5.34	6.15	6.97	7.78
1.07	0.12	0.16	0.19	0.23	0.27	0.31	0.34	0.38	0.42	0.46	0.50	0.57	0.65	0.72
48	1.51	2.01	2.50	2.99	3.48	3.97	4.46	4.95	5.44	5.94	6.43	7.41	8.39	9.38
1.22	0.14	0.19	0.23	0.28	0.32	0.37	0.41	0.46	0.51	0.55	0.60	0.69	0.78	0.87
51	1.51	2.01	2.50	2.99	3.48	3.97	4.46	4.95	5.44	5.94	6.43	7.41	8.39	9.38
1.30	0.14	0.19	0.23	0.28	0.32	0.37	0.41	0.46	0.51	0.55	0.60	0.69	0.78	0.87
60	2.03	2.69	3.34	4.00	4.66	5.32	5.98	6.63	7.29	7.95	8.61	9.92	11.24	12.56
1.52	0.19	0.25	0.31	0.37	0.43	0.49	0.56	0.62	0.68	0.74	0.80	0.92	1.04	1.17
66	2.29	3.03	3.77	4.51	5.25	5.99	6.73	7.47	8.22	8.96	9.70	11.18	12.66	14.15
1.68	0.21	0.28	0.35	0.42	0.49	0.56	0.63	0.69	0.76	0.83	0.90	1.04	1.18	1.31
78	2.54	3.37	4.19	5.02	5.84	6.67	7.49	8.31	9.14	9.96	10.79	12.44	14.09	15.74
1.98	0.24	0.31	0.39	0.47	0.54	0.62	0.70	0.77	0.85	0.93	1.00	1.16	1.31	1.46
84	2.80	3.71	4.62	5.52	6.43	7.34	8.25	9.16	10.06	10.97	11.88	13.69	15.51	17.33
2.13	0.26	0.34	0.43	0.51	0.60	0.68	0.77	0.85	0.93	1.02	1.10	1.27	1.44	1.61
96	3.31	4.39	5.46	6.54	7.61	8.69	9.76	10.84	11.91	12.98	14.06	16.21	18.36	20.51
2.44	0.31	0.41	0.51	0.61	0.71	0.81	0.91	1.01	1.11	1.21	1.31	1.51	1.71	1.91

Document Links

[Louver Finishes & Colors](#)

[Louver Product Selection Guide](#)


[Louver Products Catalog](#)

[Louver Warranty Statement](#)

Airflow Resistance

Standard Air - 0.075 lb/ft³ (1.2 kg/m³)

Test size 48 in. x 48 in. (1219 mm x 1219 mm)

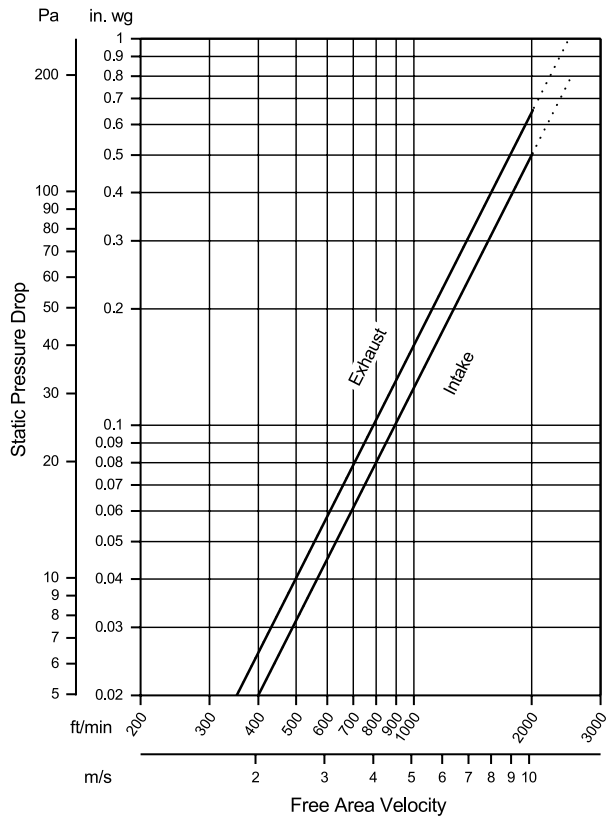


Model EAC-601 resistance to airflow (pressure drop) varies depending on louver application (air intake or air exhaust). Free area velocities (shown) are higher than average velocity through the overall louver size. See louver selection information. (Test Figure 5.5-6.5)

Water Penetration

Standard Air - 0.075 lb/ft³ (1.2 kg/m³)

Test size 48 in. x 48 in. (1219 mm x 1219 mm) Test duration of 15 min.

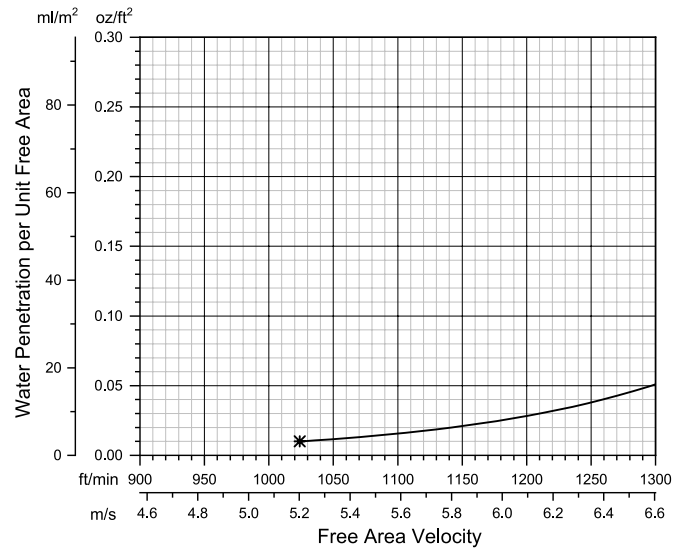

The AMCA Water Penetration Test provides a method for comparing various louver models and designs as to their efficiency in resisting the penetration of rainfall under specific laboratory test conditions. The beginning point of water penetration is defined as that velocity where the water penetration curve projects through 0.01 oz. (3 g) of water (penetration) per sq. ft. (m²) of louver free area. ***The beginning point of water penetration for Model EAC-601 is 1024 fpm (5.202 m/s) free area velocity.** These performance ratings do not guarantee a louver to be weatherproof or stormproof and should be used in combination with other factors including good engineering judgement in selecting louvers.